

Finished Grade shall be pitched to sheet flow

stormwater away from system


Cover material depth shall be $\geq 6"$ and shall be uniform over system

Septic tank effluent

CT DOT #6 distribution stone

Cover fabric

6 mil. plastic sheeting (as specified)

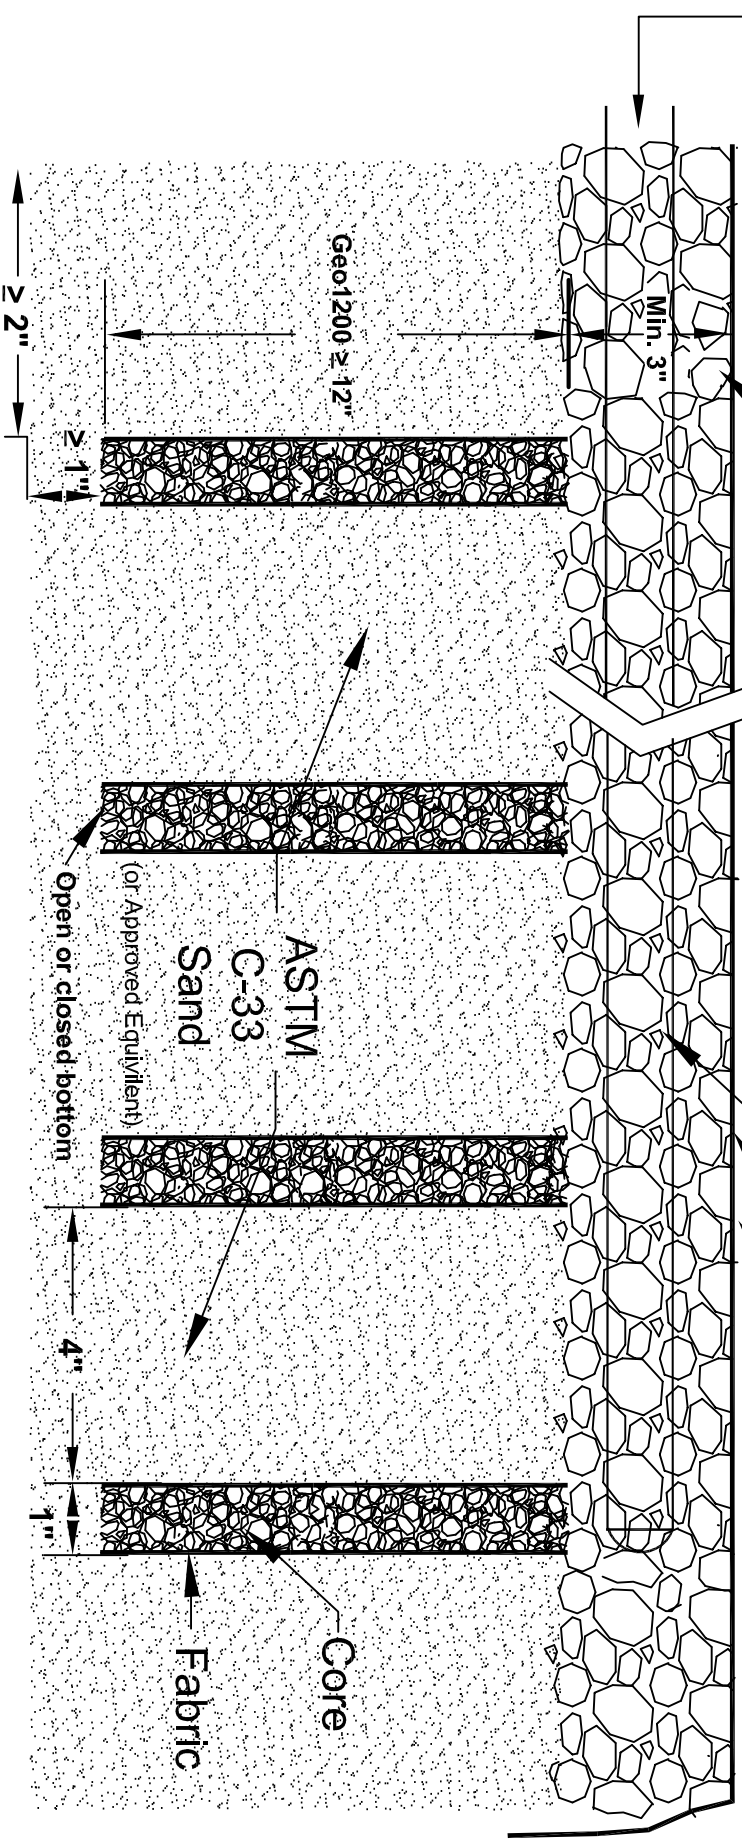

GEOMAT EDGE™ ST 1200 LEACHING SYSTEM

A-A' Cross Section

*3" min. I.D., ASTM D-3034, SDR 35 pipe for gravity applications
 0.75" min. I.D., ASTM D-2665, SCH 40 PVC pipe for pressure applications

NOTE:
 Shall only be utilized in conjunction with a flow equalization device to ensure that the interior void storage volume is not exceeded during peak flow events.

Copyright 2007 GEOMATRIX SYSTEMS, LLC
 Patents Pending

GEOMAT EDGE ST LEACHING SYSTEM		REV. E	
A-A' Cross Section		ACAD. NO. GME-ST-A-SHEET REVISIONS	
Geomatrix Systems, LLC., Killingworth, CT		860-663-3993	
SCALE	NONE	REV.	E
DATE	7/2/07	ACAD. NO.	GME-ST-A-SHEET REVISIONS
DRAWN BY:	ERP	SHEET	2 OF 4